


INSIDE ELEVATION


NOTES:

- * DOORS & HARDWARE WILL BE DESIGNED & MANUFACTURED & INSTALLED ACCORDING TO STANDARDS ESTABLISHED BY THE DOOR ACCESS SYSTEMS MANUFACTURING ASSOCIATION (DASMA).
- * IN DOOR SECTIONS WHERE WINDOW LITES ARE INSTALLED, STRUTS MAY BE RELOCATED OVER HINGE LEAFS TO AVOID OBSTRUCTION.
- * AN INSIDE SLIDE LOCK SHOULD BE MOUNTED ON END STILE APPROXIMATELY 31" FROM BOTTOM OF DOOR ON THE INTERIOR LEFT.


TOP BRACKET DETAIL
DETAIL 1/S1.1

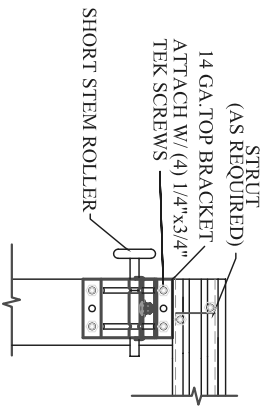


BOTTOM BRACKET DETAIL
DETAIL 2/S1.1

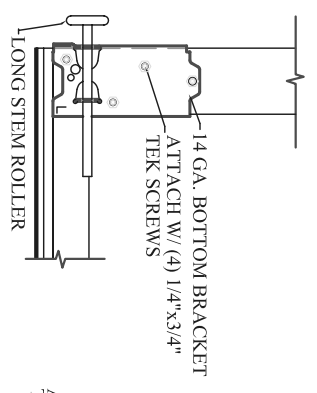




END HINGE DETAIL
DETAIL 3/S1.1

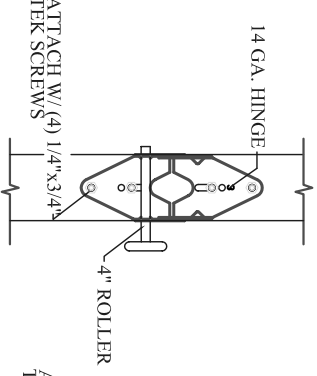

STRUT DETAIL
DETAIL 4/S1.1



JAMB BRACKET DETAIL
DETAIL 5/S1.1

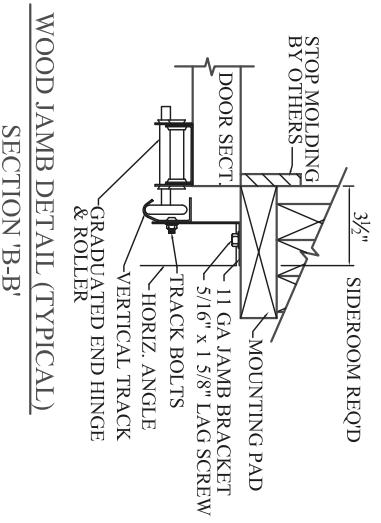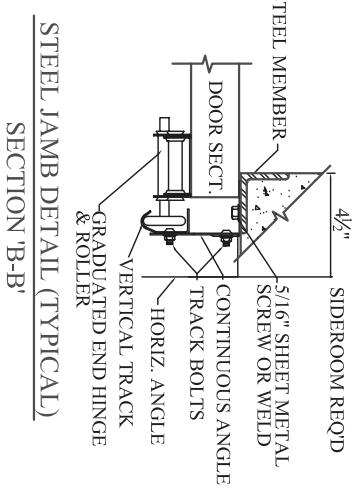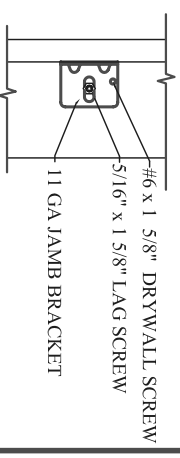

MODEL: RS-25

DESIGN PRESSURE +12.4/-13.8 PSF

TEST PRESSURE +18.6/-20.7 PSF

TESTED PER THE APPLICABLE REQUIREMENTS OF: ASTM: E 330 ANSII/DASMA 108-2002

NOTE: THE DESIGN OF SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE IN ACCORDANCE WITH CURRENT BUILDING CODES



ENGINEERING DRAWING

TITLE
18' 2" MAX. WIDTH WIND LOAD RATED DOOR

MODEL # RS-25, 24 & 25 gauge

SCALE - N/A

REV. NO. 3 **OF** _____

SHEET _____

DATE _____