



NOTES:


- * DOORS & HARDWARE WILL BE DESIGNED & MANUFACTURED & INSTALLED ACCORDING TO STANDARDS ESTABLISHED BY THE DOOR ACCESS SYSTEMS MANUFACTURING ASSOCIATION (DASMA).
- * IN DOOR SECTIONS WHERE WINDOW LITES ARE INSTALLED, STRUTS MAY BE RELOCATED OVER HINGE LEAFS TO AVOID OBSTRUCTION.
- * AN INSIDE SLIDE LOCK SHOULD BE MOUNTED ON END STILE APPROXIMATELY 31" FROM BOTTOM OF DOOR ON THE INTERIOR LEFT.

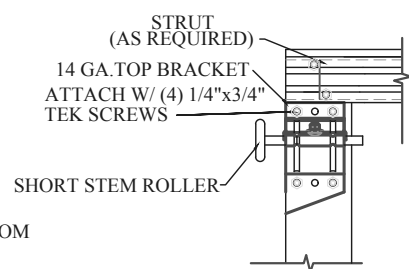


TOP BRACKET DETAIL
DETAIL 1/S1.1

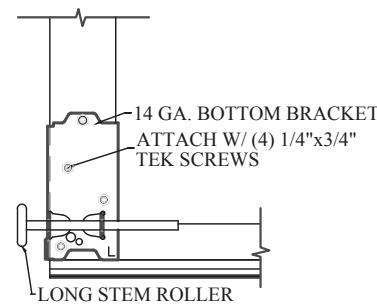


BOTTOM BRACKET DETAIL
DETAIL 2/S1.1

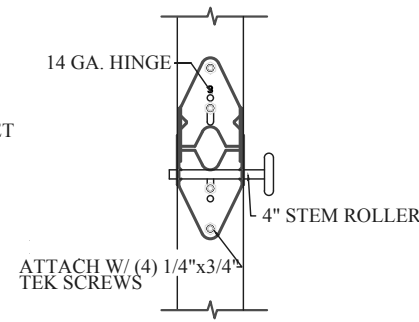


END HINGE DETAIL
DETAIL 3/S1.1




STRUT DETAIL
DETAIL 4/S1.1

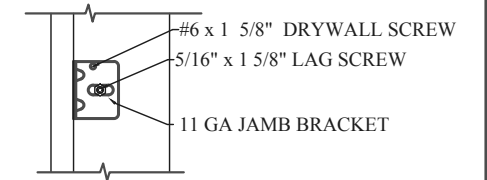

JAMB BRACKET DETAIL
DETAIL 5/S1.1

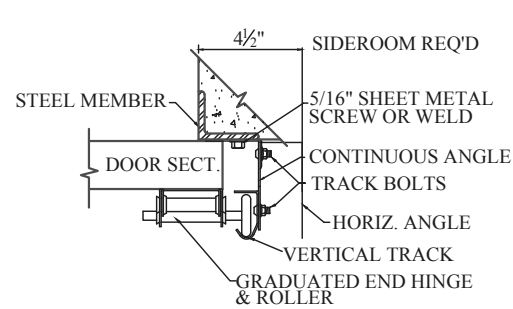


STEEL JAMB DETAIL (TYPICAL)
SECTION 'B-B'

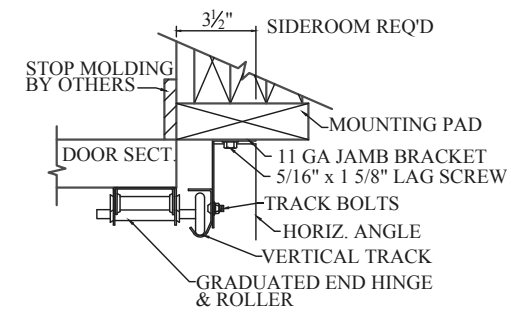

WOOD JAMB DETAIL (TYPICAL)
SECTION 'B-B'

MODEL: TR-II
 DESIGN PRESSURE +12.4/-13.8 PSF
 TEST PRESSURE +18.6/-20.7 PSF
 TESTED PER THE APPLICABLE REQUIREMENTS OF:
 ASTM: E 330 ANSI/DASMA 108-2002

NOTE: THE DESIGN OF SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE IN ACCORDANCE WITH CURRENT BUILDING CODES

		ENGINEERING DRAWING	
TITLE 18'-2" MAX. WIDTH, WIND LOAD RATED DOOR			
MODEL # TR-II	REV. NO. 3	SHEET _____	OF _____
SCALE - N/A	DATE _____		