


D	# OF STRUTS
6' to 8'	4 STRUTS
8'3" to 10'	5 STRUTS
10'3" to 12'	6 STRUTS
12'3" to 14'	7 STRUTS
14'3" to 16'	8 STRUTS
16'3" to 18'	9 STRUTS
18'3" to 20'	10 STRUTS


PLACE ONE STRUT ON EVERY SECTION

NOTES:


- * DOORS & HARDWARE WILL BE DESIGNED & MANUFACTURED & INSTALLED ACCORDING TO STANDARDS ESTABLISHED BY THE DOOR ACCESS SYSTEMS MANUFACTURING ASSOCIATION (DASMA).
- * IN DOOR SECTIONS WHERE WINDOW LITES ARE INSTALLED, STRUTS MAY BE RELOCATED OVER HINGE LEAFS TO AVOID OBSTRUCTION.
- * AN INSIDE SLIDE LOCK SHOULD BE MOUNTED ON END STILE APPROXIMATELY 31" FROM BOTTOM OF DOOR ON THE INTERIOR LEFT.

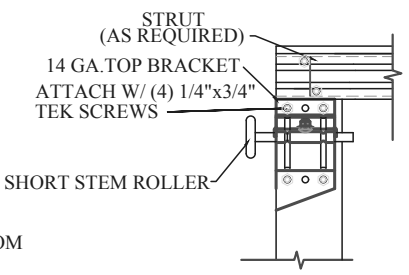


TOP BRACKET DETAIL
DETAIL 1/S1.1

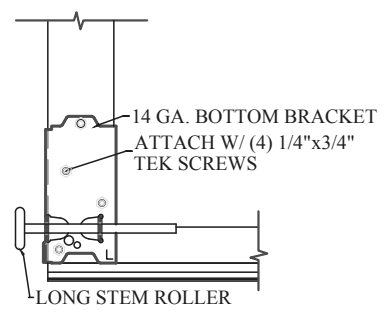


BOTTOM BRACKET DETAIL
DETAIL 2/S1.1

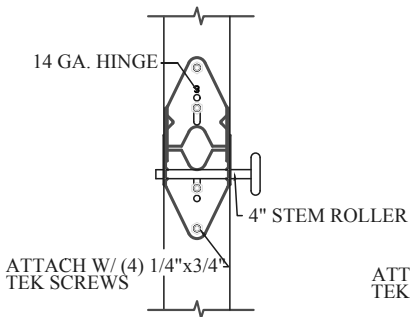


END HINGE DETAIL
DETAIL 3/S1.1




STRUT DETAIL
DETAIL 4/S1.1

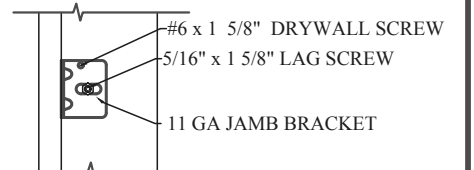

JAMB BRACKET DETAIL
DETAIL 5/S1.1

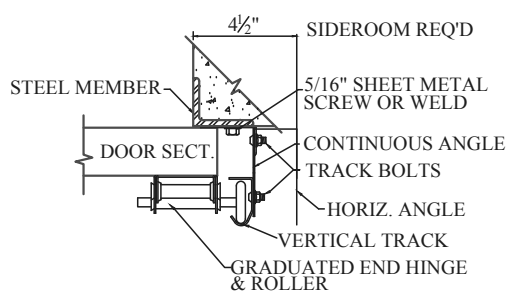

STEEL JAMB DETAIL (TYPICAL)
SECTION 'B-B'

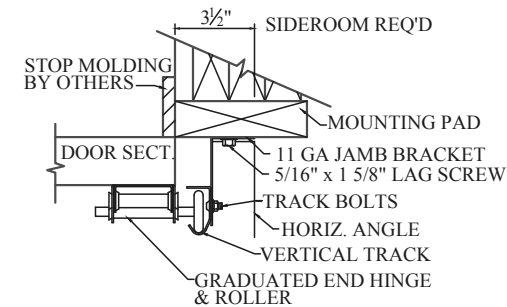

WOOD JAMB DETAIL (TYPICAL)
SECTION 'B-B'

MODELS: All 1 3/8" Models, All 2" Models (Except TF-II)
DESIGN PRESSURE +18.2/-20.1 PSF

TESTED PER THE APPLICABLE REQUIREMENTS OF:
Pressures conform to ASCE-7-10 with the following parameters:
115 mph ultimate design wind speed
Exposure C
ASTM: E 330 ANSI/DASMA 108-2002

NOTE: THE DESIGN OF SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE IN ACCORDANCE WITH CURRENT BUILDING CODES



ENGINEERING DRAWING

BEMIDJI, MN 56601

TITLE		11'2" MAX. WIDTH, WIND LOAD RATED DOOR	
MODEL #	AR-138, ARL-138, LP-138, TF-138 TR-138, AR-II, ARL-II, LP-II, TR-II	REV. NO.	0
SCALE	N/A	SHEET	OF
		DATE	