
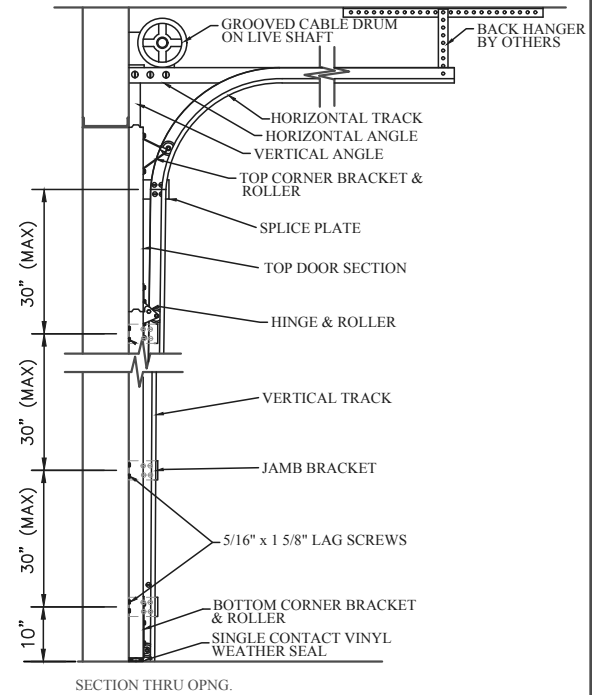


D	# OF STRUTS
6'	3 C-CHANNEL
7' to 8'	4 C-CHANNEL
8'3" to 10'	5 C-CHANNEL
10'3" to 12'	6 C-CHANNEL
12'3" to 14'	7 C-CHANNEL
14'3" to 16'	8 C-CHANNEL
16'3" to 18'	9 C-CHANNEL
18'3" to 20'	10 C-CHANNEL

PLACE ONE 4" C-CHANNEL ON EVERY SECTION







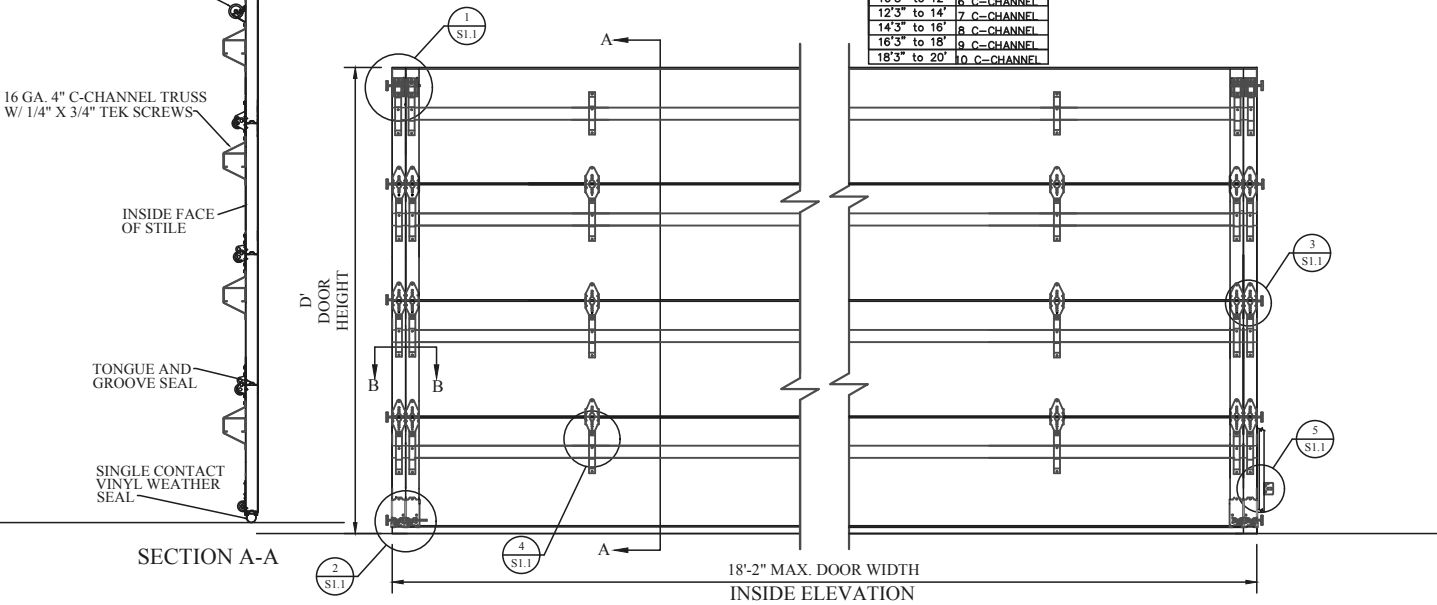


NOTES:

* DOORS & HARDWARE WILL BE DESIGNED & MANUFACTURED & INSTALLED ACCORDING TO STANDARDS ESTABLISHED BY THE DOOR ACCESS SYSTEMS MANUFACTURING ASSOCIATION (DASMA).

* IN DOOR SECTIONS WHERE WINDOW LITES ARE INSTALLED, STRUTS MAY BE RELOCATED OVER HINGE LEAFS TO AVOID OBSTRUCTION.

* AN INSIDE SLIDE LOCK SHOULD BE MOUNTED ON END STILE APPROXIMATELY 31" FROM BOTTOM OF DOOR ON THE INTERIOR LEFT.

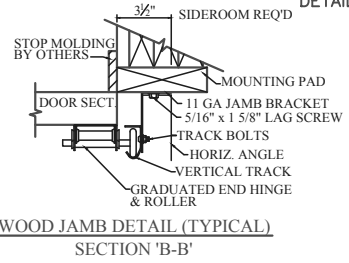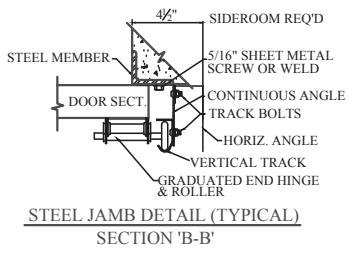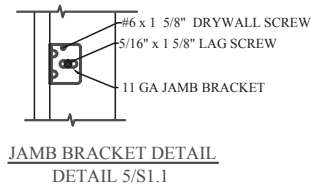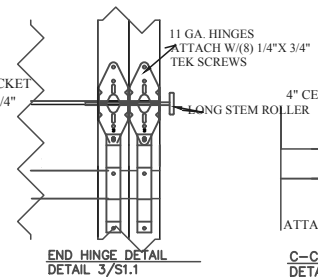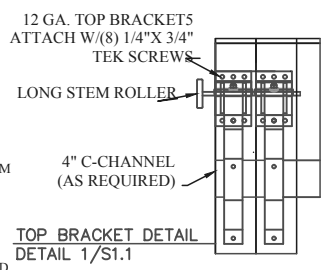

MODELS: ALL 2" MODELS

DESIGN PRESSURE +16.5/-18.4 PSF

EXPOSURE C

TESTED PER THE APPLICABLE REQUIREMENTS OF:

ASTM: E 330 ANSI/DASMA 108-2002

NOTE: THE DESIGN OF SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE IN ACCORDANCE WITH CURRENT BUILDING CODES

<p>northcentral DOOR COMPANY BEMIDJI, MN 56601</p>	ENGINEERING DRAWING	
	TITLE 18'-2" MAX. WIDTH, WIND LOAD RATED DOOR	
MODEL # TF-II, TR-II, LP-II, AR-II, ARL-II	SCALE - N/A	REV. NO. 0 OF 0 SHEET DATE